

Mechanical Motion Sensor 98940-A Series

GENERAL DESCRIPTION

The No. 98940-A Series Mechanical Motion Sensor is a snap-acting valve operated by mechanical motion and designed for use with Engine Control Panel components.

The sensor is used to vent a pneumatic signal when the trip lever is actuated.




SPECIFICATIONS

Construction: Brass body, stem and actuating lever. Elastomer O-rings. Steel trip-lever, cover and mounting brackets-cadmium plated and bi-chromate dipped. Stainless steel springs.

Models Available:

98940-A2 - Manual Reset 98940-A3 - Pneumatic or Manual Reset Ordering Information: Specify:

- (1) Model
- (2) Any special features



J.I.C. Symbol

A. GENERAL

Tubing and fittings used to connect sensor must be free of chips, dirt, moisture or other foreign matter. If compound or shellac is used, apply it above second or third male thread in moderate amount. Do not allow compound to be deposited inside sensor.

For continuous, trouble-free operation, the supply to the sensor must be clean and dry.


B. MOUNTING

When installing the No. 98940 sensor, care must be taken to prevent any foreign matter from entering the ports.


The sensor may be installed in any position and should be securely mounted, using the four holes (clearance for No. 10 screws) provided in the mounting brackets. (See Fig. 1)

C. CONNECTIONS

Consult system schematic.

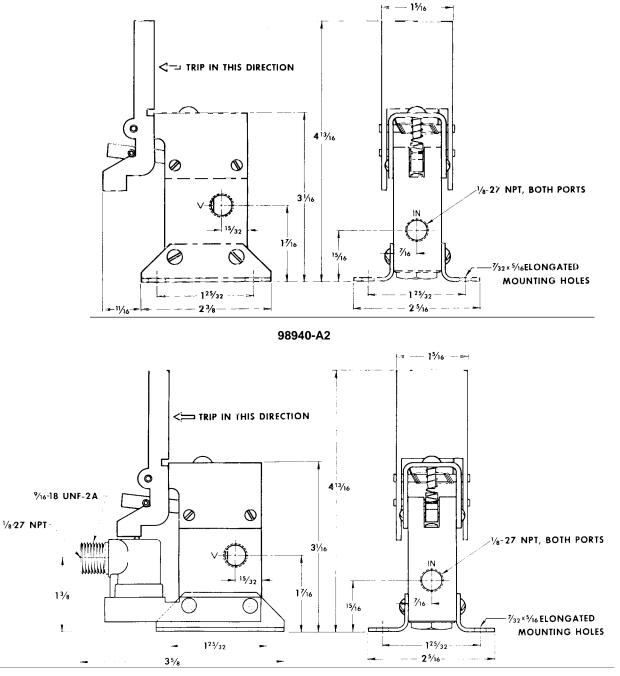

98940-A3

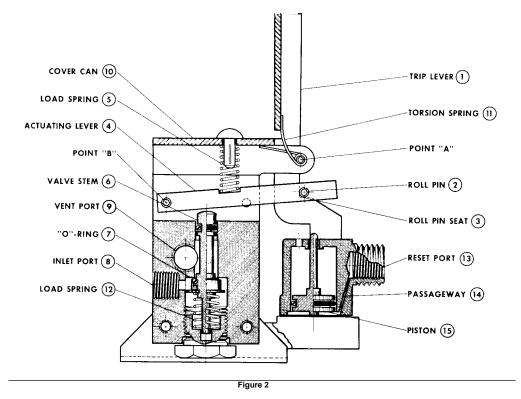

A. TRIP CYCLE

The Trip Lever, which receives the force to be monitored, rotates about Point "A." The Actuating Lever, which actuates the valve, rotates around Point "B."

Sufficient force applied to Trip Lever (1) in the direction indicated causes it to rotate in a clockwise direction, allowing Roll Pin (2) to move out of Seat (3) and down incline. The roll pin, being connected to the Actuating Lever (4), is forced downward by Load Spring (S) acting on actuating lever. As actuating lever falls, it forces Valve Stem (6) downward, moving O-Ring (7) off seat. Pressure then flows from Inlet Port (8) out through Vent Port (9).

B. RESET CYCLE

1. Manual Reset (98940-A2):

With manual force applied in an upward direction to the trip lever, the roll pin travels up the incline and into Roll Pin Seat (3). Torsion Spring (11) provides a detent to hold trip lever in place. As the roll pin seats and the actuating lever moves upward, the valve stem is forced upward by Load Spring (12). This action permits O-ring to seat and blocks flow between Inlet and Vent Ports.

2. Pneumatic Reset (98940-A3):

A signal supplied to Piston (15) through Reset Port (13), flows through Passageway (14) to bottom of piston, forcing the piston upward. The piston stem forces the actuating lever up, allowing the roll pin to move up the incline and into roll pin seat. Torsion Spring (11) furnishes the force necessary to rotate the trip lever counterclockwise. From this point the valve seating operation is the same as described in the manual operation (above).

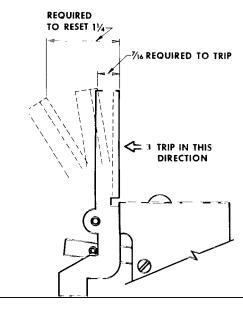


Figure 3

| RELAY NO. | LOAD REQUIRED TO TRIP* | LOAD REQUIRED TO RESET* | |
|--------------|---------------------------|----------------------------------|--|
| 98940-A2 | 1 lb. | 6 lb. | |
| 98940-A3 | 1 lb. | Pneumatic Reset (20 psi min.) | |

*Approximate values measured 2" from pivot point.


MAINTENANCE

WARNING: Disassemble carefully-spring-load forces present.

If sensor does not function properly due to leakage or contamination by foreign matter, disassemble and clean all metal parts with non-flammable solvent and dry thoroughly.

After reassembly, check for external leakage. Retighten assembly screws as necessary. Gasket cement should not be used to seal leaks due to the possibility of plugging small passages.

PARTS LIST

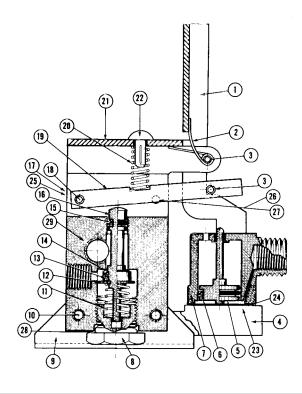

CAUTION:

If cleaning is required, do not subject O-rings, poppets or gaskets to cleaning fluid, acetone, or any halogenated hydrocarbons such as vapor degrease liquids, etc. Clean only with a soft, dry cloth.

Upon reassembly, the O-rings should be lubricated with a silicone-type lubricant.

Do not permit lubricant to get on poppets or valve seats.

| Item | No. | Description | Part No. |
|------|-------|-----------------------------|-------------|
| No. | Re 'd | * | |
| 1 | 1 | Lever | 29846-A1 |
| 2 | 1 | Torsion Spring | 29850-A1 |
| 3 | 2 | Roll Pin | 36606-A14 |
| 4 | 1 | Bracket | 29841-A1 |
| 5 | 1 | Piston | 29843-A1 |
| 6 | 1 | O-Ring | 36240N0014 |
| 7 | 1 | Cylinder | 24513-A 1 |
| 8 | 1 | Plug | 24536-A1 |
| 9 | 2 | Bracket | 24637-A3 |
| 10 | 4 | Screw | 33713G1209 |
| 11 | 1 | Spring | 24537-A1 |
| 12 | 1 | Retaining Ring | 36605Q8 |
| 13 | 1 | O-Ring Retainer | 24534-A1 |
| 14 | 1 | O-Ring | 36240V0010 |
| 15 | 1 | O-Ring | 36240V0007 |
| 16 | 1 | Stem | 24531-A1 |
| 17 | 1 | "E" Ring for Item No. 18 | 36605Q3 |
| 18 | 1 | Pin | 29844-A2 |
| 19 | 1 | Lever | 29848-A1 |
| 20 | 1 | Spring | 29845-A1 |
| 21 | 1 | Cover | 29849-A1 |
| 22 | 1 | Drive-Stud | 29851-A1 |
| 23 | 4 | Reset Piston Mounting Screw | 33705-G1100 |
| | | (Not Shown) | |
| 24 | 1 | Gasket | 24517-A1 |
| 25 | 1 | Push-On Nut for Item No. 18 | 36603D2 |
| 27 | 2 | Screw (Not Shown) | 33711 L0902 |
| 28 | 1 | Gasket | 29623-A1 |
| 29 | 1 | Relay Body | 29840-A1 |

NOTE 1: 98940-A3 Shown. For 98940-A2, delete items 4, 5, 6, 7, 23, & 24.

NOTE 2: Items No. 1, 2, 3, 21, & 22 may be ordered assembled as "Lever Assembly 81838-A1."

> Schneider Electric Systems USA, Inc

1602 Mustang Dr Maryville, TN 37801 Ph (865) 981-3100 FX (865) 981-3168

Q-4020 (2/19)

Printed in U.S.A.